



MAR 02, 2009 2:54 PM WELLS0093D\03\0085\03S14086G-COMMAND POST\CADD\TYPE B1 DESIGN SERVICES\MECH\HEAT\H101.DWG - A101

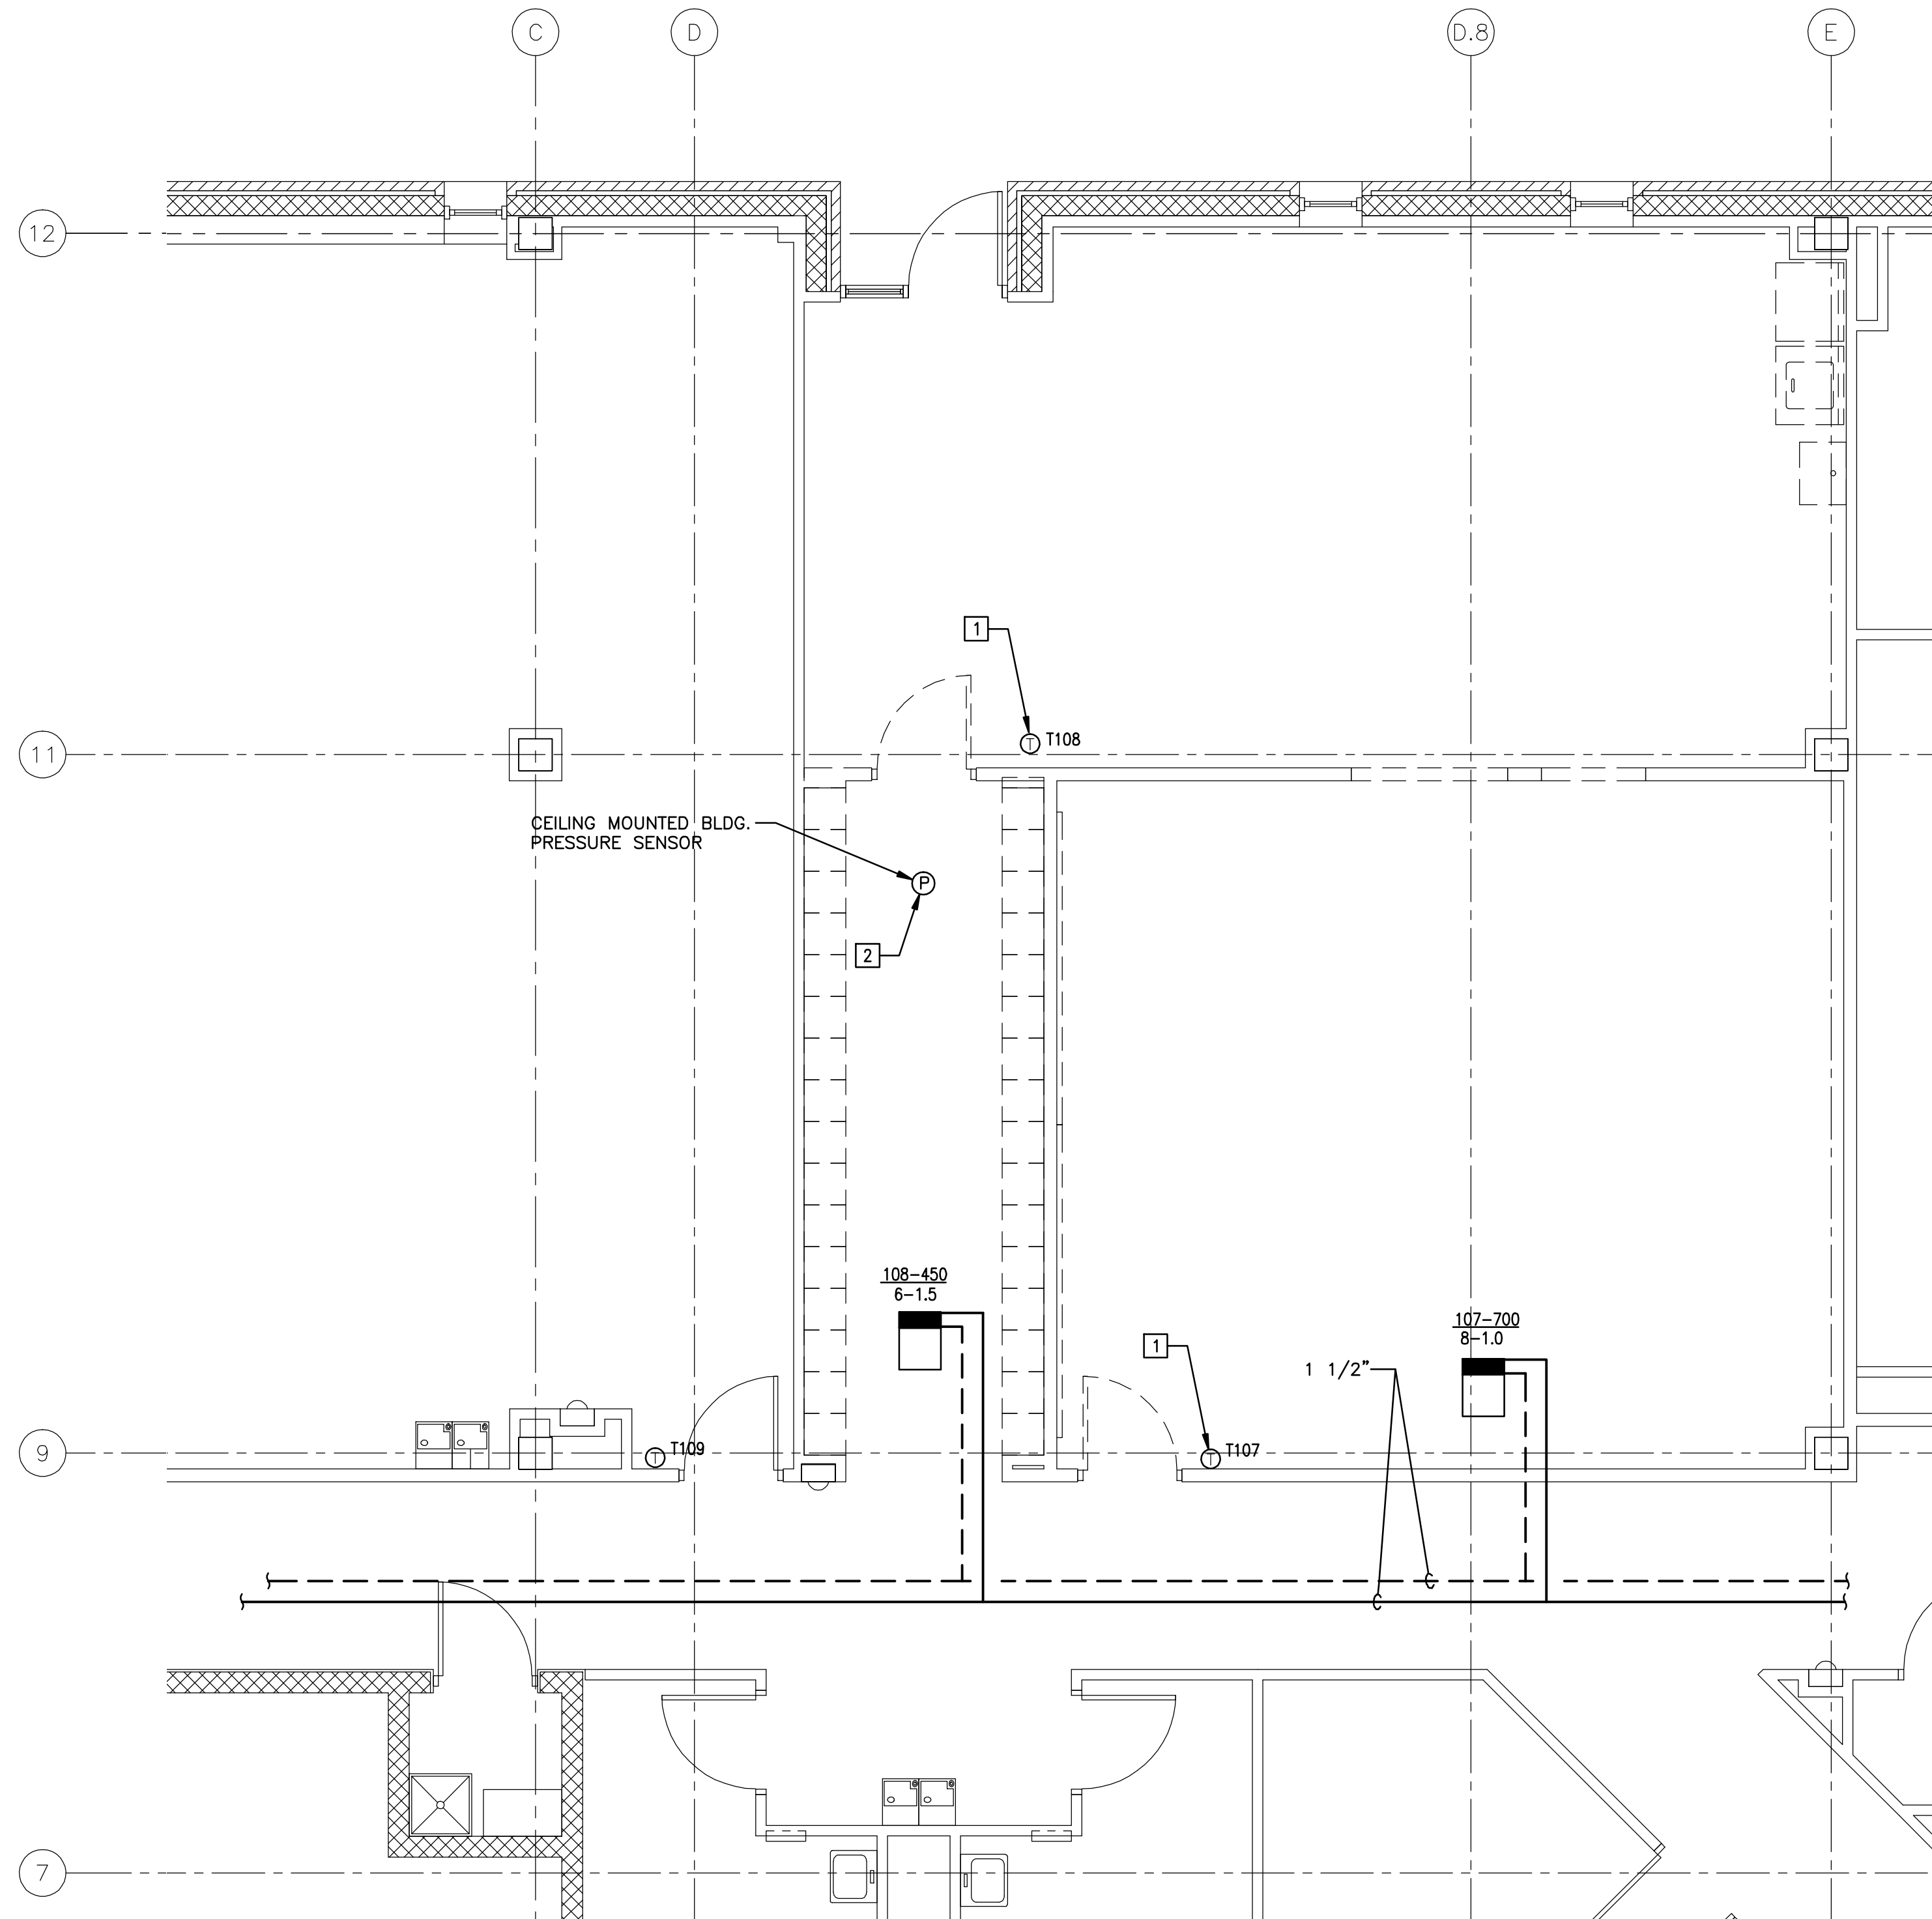

PARTIAL FIRST FLOOR PLAN - HEATING - DEMOLITION

0 2' 4' 8'
SCALE: 1/4" = 1'-0"

KEY NOTES — DEMOLITION:

- 1 DISCONNECT AND REMOVE EXISTING WALL MOUNTED THERMOSTAT AND SAVE FOR RELOCATION AS SHOWN ON NEW WORK PLAN.
- 2 DISCONNECT AND REMOVE PRESSURE SENSOR AND SAVE FOR RELOCATION AS SHOWN ON NEW WORK PLAN.

LEGEND:

HW REHEAT COIL	INDICATES COIL WITH 3-WAY VALVE. COILS WITHOUT '*' SHALL HAVE 2-WAY VALVE
COIL #	120-750 CFM
BOX SIZE	9-2.5 HW GPM
T107 - DDC WALL STAT FOR VAV BOX #107	
P - BUILDING PRESSURE SENSOR	

DATE	REVISION



183rd Fighter Wing
Illinois Air National Guard



HANSON PROJECT			
FILENAME H101.DWG			
SCALE 1/4" = 1'-0"			
DATE 03/02/09			
LAYOUT	HWH	8/11/08	
DRAWN	HWH	8/11/08	
REVIEWED	ATK	8/14/08	



Hanson Professional Services Inc.
1525 South Sixth Street
Springfield, Illinois 62703-2886

**PARTIAL FIRST FLOOR PLAN
DEMOLITION**

COMMAND POST (CP) RELOCATION
183D FIGHTER WING
SPRINGFIELD, IL

H1.1